


ANDEN DEHUMIDIFIERS

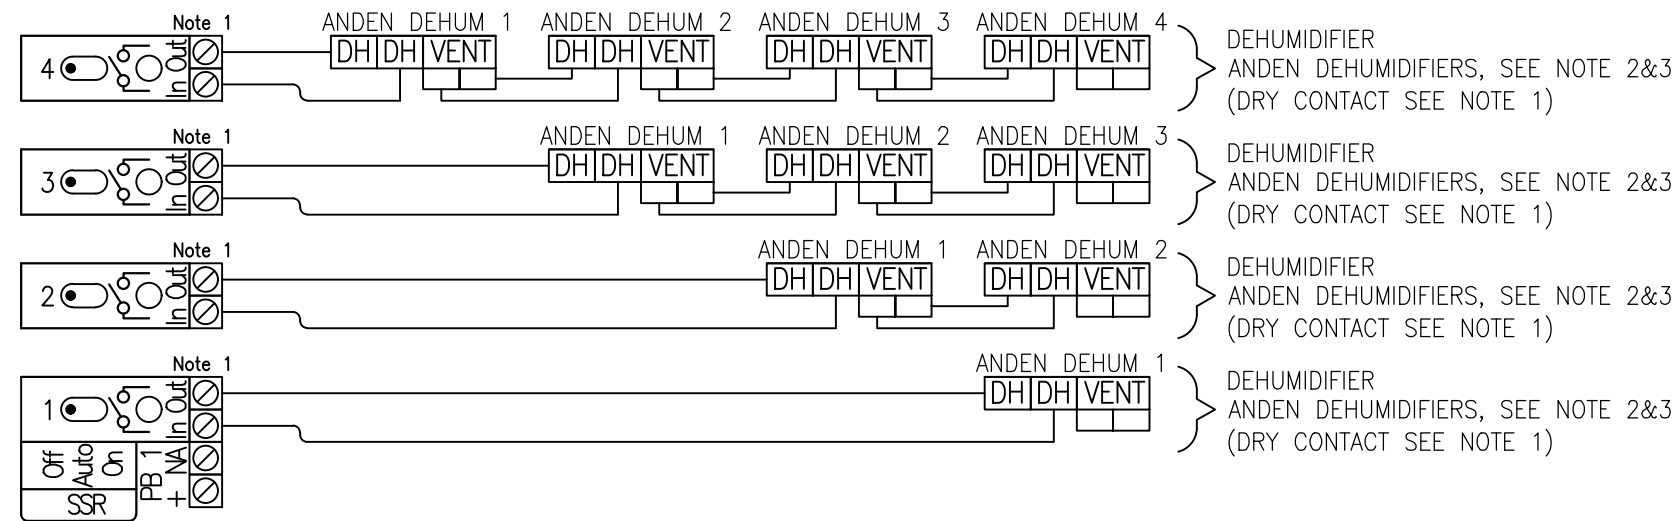

24VAC Output 1
2.5A Max +

NOTES:

1. FOR ANY OUTPUT THAT REQUIRES A DRY CONTACT, REMOVE THE BLUE JUMPER FROM THAT OUTPUT.
2. SET ANDEN UNIT TO EXTERNAL MODE.
3. SET ANDEN CONTROL DIP SWITCH TO NORMALLY OPEN ("NO").

ANDEN LOW VOLTAGE TERMINAL

